



Project No:

723137

Project acronym:

MultiPACK

Project full title:

Demonstration of the next generation standardised integrated cooling and heating packages for commercial and public buildings based on environment-friendly carbon dioxide vapour compression cycles

Type of Action:

IA (Innovation Action)

Call/Topic:

**H2020-EE-2016-RIA-IA/
EE-03-2016**

Standardised installation packages integrating renewable and energy efficiency solutions for heating, cooling and/or hot water preparation

D2.8**Educational e-book about MultiPACK No 1**

Submission due date: 30.06.2017

Actual delivery date: 30.06.2017

Organisation name of lead beneficiary for this deliverable:

NTNU

Project funded by the European Commission within the Horizon 2020 Programme (2014-2020)		
Dissemination Level		
PU	Public	X
CO	Confidential, only for members of the consortium (including the Commission Services)	

Deliverable number:	D2.8
Deliverable title:	Educational e-book about Multipack No 1
Deliverable description:	The educational material - including manuals, guidelines, books, case study files - will be available at the project website. First e-book is to be issued in Month 9.
Work package:	WP2
Lead participant:	NTNU

Revision Control (only when an uploaded deliverable is revised)			
Revision	Date	Author(s)	Comments
1.0	30.06.2017	Paride Gullo	

Quality Assurance, status of deliverable		
Action	Performed by	Date
Verified	Armin Hafner	30.06.2017
Reviewed (WP Leader)	Armin Hafner	30.06.2017
Approved (GA)	Armin Hafner	30.06.2017
Uploaded to EASME (Coordinator)	NTNU	30.06.2017

Delivered		
Author(s) Name	Organisation	E-mail address
Paride Gullo	NTNU	gullo.paride@spes.uniud.it
Lorenzo Fusini	NTNU	lorenzo.fusini@ntnu.no
Armin Hafner	NTNU	armin.hafner@ntnu.no

Table of Contents

	Page
1 PREFACE	4
2 INTRODUCTION	5
3 SUPERMARKET APPLICATIONS.....	6
3.1 Evolution of CO ₂ technologies.....	6
3.2 The multi-ejector concept.....	7
3.3 “All-in-one” concept.....	9
4 REVERSIBLE HEAT PUMPING APPLICATIONS	14
5 CONCLUSIONS AND FUTURE WORK	18
6 NOMENCLATURE	19
7 REFERENCES.....	20

Table of Figures

	Page
Figure 3.1 1st (booster), 2nd (parallel compression) and 3rd (ejector supported parallel compression) generation of transcritical CO ₂ refrigeration system architecture for supermarket applications (Nekså et al., 2016).	6
Figure 3.2 Throttling losses related to a vapour-compression refrigeration system using R744, R134a and R410A in a T-s diagram (Elbel and Lawrence, 2016).	7
Figure 3.3 Multi-ejector block and its main components (Hafner and Banasiak, 2016).	9
Figure 3.4 Fully integrated CO ₂ refrigeration system for supermarkets located in Southern European locations with LT and MT cooling loads, hot water demand, heating & cooling demand for the building and an auxiliary heat sink (Hafner, 2017).	10
Figure 3.5 Integration of direct heating and cooling fan coils and air curtains in CO ₂ commercial refrigeration units equipped with AC multi-ejector module.	11
Figure 3.6 Integration of direct heating and cooling fan coils and air curtains in CO ₂ commercial refrigeration units (ejector partly by-passed during AC) (Hafner, 2017).	12
Figure 3.7 Integration of direct heating and cooling fan coils and air curtains in CO ₂ commercial refrigeration units (ejector utilized also during AC) (Hafner, 2017).	13
Figure 4.1 Final energy consumption by sector in European Union (Jakobs et al., 2010).	14
Figure 4.2 Breakdown of the energy consumption in a typical large hotel (< 100 rooms) in hot climates (Adriansyah, 2001).	15
Figure 4.3 Schematic of a R744 heat pump system for tap water heating and equipped with an ejector (Minetto et al., 2015b).....	16
Figure 4.4 Schematic of a R744 heat pump system for space cooling and equipped with an ejector (Minetto et al., 2015b).	17

1 PREFACE

A dedicated section on the project website will hold the educational material – including manuals, guidelines, books, case study files for computational software and other material – and allow for a basic filtering of information for easy access of website users (available also in South European languages). The material, developed by all project partners throughout the project will be made available as free downloads and for direct integration into supranational, national and regional conferences and workshops. Educational and knowledge-building promotional material presented will be a direct result from the MultiPACK project activities but might also list other case studies and material in line with the project's core ambition to familiarise the HVAC&R market stakeholders, as well as legislators and the wider public, with available efficient integrated heating and cooling solutions. Specific material will also be developed for addressing individual target groups, taking into considerations their peculiarities, as for example, in the case of big supermarket chains, small family-owned shops, hotel chains, public institutions.

The present deliverable includes all the contents of the first educational e-book about MultiPACK. The actual e-book, with the correct design and formatting, can be downloaded from the [Downloads section of the project's website](#).

2 INTRODUCTION

The EU F-Gas Regulation 517/2014 aims at progressively reducing the supply of hydrofluorocarbons (HFCs) to the EU market by 79% by 2030 compared to average levels in 2009-2012 (European Commission, 2014). To satisfy its requirements the average value of the Global Warming Potential (GWP) of the working fluids in use today has to be brought from the current $2000 \text{ kg}_{\text{CO}_2, \text{equ}} \cdot \text{kg}_{\text{refrigerant}}^{-1}$ down to $400 \text{ kg}_{\text{CO}_2, \text{equ}} \cdot \text{kg}_{\text{refrigerant}}^{-1}$ by 2030 in the whole refrigeration sector (Shecco, 2016). As regards supermarket applications, the commencement of the aforementioned legislative act decreed the ban of fluorinated greenhouse gases with a $\text{GWP} \geq 150$ in multipack centralized refrigeration systems having a rated capacity $\geq 40 \text{ kW}$. An exception was made with respect to the primary working fluid circuit of cascade arrangements, in which the usage of the refrigerants with a $\text{GWP} < 1500$ is still allowed (European Commission, 2014). This strict imposition was due to the enormous carbon footprint featured in commercial refrigeration applications. In fact, the average annual refrigerant leakage rate related to the European food retail industry is equal to 15%-20% of the total charge, with R404A the most employed working fluid (Hafner et al., 2014a). However, on global perspectives this reaches a value of approximately 30%, with HCFC-22 the most popular refrigerant (Hafner et al., 2014a). In addition to the aforementioned regulation some European countries have approved taxes on HFC purchases, such as $55.3 \text{ €} \cdot \text{kg}^{-1}$ in Norway and $26 \text{ €} \cdot \text{kg}^{-1}$ in Spain. Therefore, transcritical CO_2 (or “ CO_2 only” or pure CO_2) refrigeration systems are perceived to be permanent replacements for synthetic refrigerant-based solutions in the refrigeration sector. In fact, CO_2 (or R744) is a readily available, non-toxic, non-flammable and low-cost refrigerant possessing an irrelevant GWP and favorable thermo-physical characteristics. Also, additional energy benefits can be obtained by implementing heat recovery to partly or completely satisfy both the space heating and domestic hot water (DHW) demands (Reinholdt and Madsen, 2010; Sawalha, 2013; Polzot et al., 2016a, 2016b; Karampour and Sawalha, 2015, 2017). Furthermore, according to Reinholdt and Madsen (2010) this technique also involves satisfying payback times. The usage of such HFC-free technologies has taken root in Northern Europe thanks to their great energy and environmental performance in cold regions (Sawalha, 2008). However, due to the fact that transcritical running modes can commonly take place in such solutions, their energy efficiency is dramatically compromised in countries with a high ambient temperature. On the other hand, the coming into force of the EU F-Gas Regulation 517/2014 has led to both conspicuous advancements and a continuous cost-optimisation of “ CO_2 only” refrigeration plants for supermarket applications (Shecco, 2016). Nowadays it is possible to claim that R744 has demonstrated to be the most energy efficient and environmentally benign alternative to high-GWP refrigerants in the food retail industry, since the system layout is adapted to the unique characteristics of this working fluid (Gullo et al., 2017a, 2017b, 2016b; Hafner et al., 2016, 2014a; Minetto et al., 2014a, 2014b). This has also been revealed by the enormous growth in the number of installations featuring such HFC-free technologies in Europe, more specifically an increase by three times in 2016 compared to 2013’s level (Shecco, 2016). As reported by Shecco (2016), a similar trend has been detected in both Norway and Switzerland, whereas in Mediterranean area a raise by about 8 times occurred over the same period of time. Europe is the world’s current leader in commercial pure R744 refrigeration plants, having 8732 systems out of approximately 11000 units (Shecco, 2016). In addition, the growing interest in the environment protection and the gliding temperature heat rejection in the high-pressure heat exchanger (i.e. gas cooler), as well as the various advantages (e.g. high volumetric cooling capacity, low pressure ratios) related to the design, make R744 particularly suitable as a working fluid for some heat pump units (Nekså et al., 1998). On the other hand, an enormous lack of confidence in both R744 refrigeration and R744 heat pumping solutions distinguishes the Mediterranean area, where the warm climate constitutes a significant challenge for such arrangements. In order to appropriately overcome this drawback, activities promoting the installation and monitoring of such HFC-free technologies in some relevant test sites in Southern Europe should be enormously fostered. A further push towards the adoption of such a refrigerant in applications involving high energy demand buildings (i.e. food retails, gyms, hotels, etc.) is being given by the continuous increase in the price of HFCs. Shecco (2016) estimated that the entry into force of the EU F-Gas Regulation 517/2014 caused that R407A, R410A, R407C and R134a went up by 10% in price in 2016, whereas R404A became 15% more expensive over the same period of time. It is also worth remarking that, thanks to its negligible GWP, HFO-1234ze(E) has also gained noteworthy attention in supermarket applications in the last few years. However, its usage has to be strongly discouraged for many reasons, such as dramatic cost, flammability, production of toxic by-products due to both its manufacturing and its decomposition into the atmosphere, etc.

3 SUPERMARKET APPLICATIONS

3.1 Evolution of CO₂ technologies

The first transcritical booster system (left-hand side in Figure 3.1) was developed in 2006 by the Danish Technological Institute and installed in a small Danish store in March 2007 (European Commission, 2008). In relation to a R404A refrigerating unit, it was found that its environmental impact and required annual electricity are 4% and 52% lower, respectively (European Commission, 2008). As a result, this technology has had a great success in Northern and Central Europe, representing the 1st generation as well as the “old” benchmark for transcritical CO₂ supermarket refrigeration technologies. This solution was comprehensively studied by Ge and Tassou (2011a, 2011b).

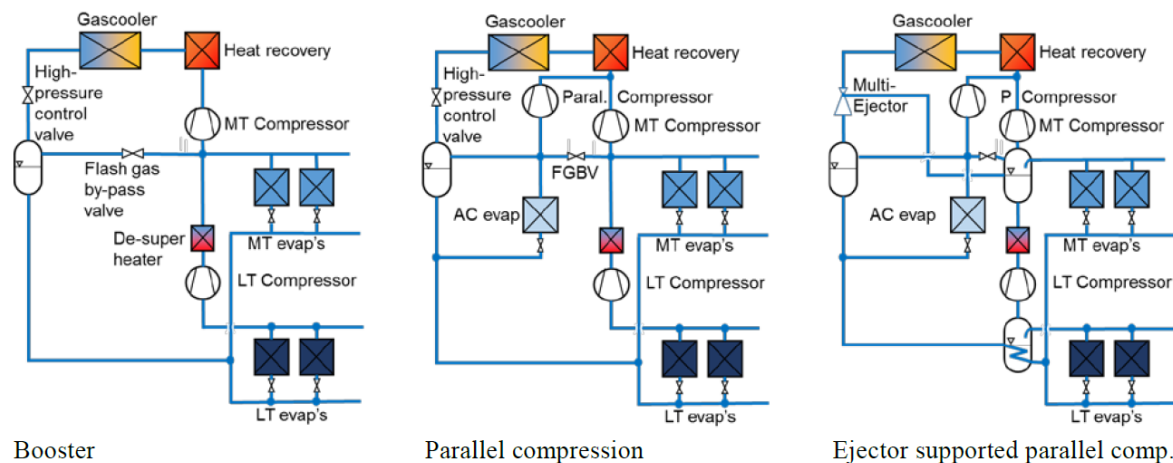


Figure 3.1 1st (booster), 2nd (parallel compression) and 3rd (ejector supported parallel compression) generation of transcritical CO₂ refrigeration system architecture for supermarket applications (Nekså et al., 2016).

A simple expedient to enhance moderately the overall system performance is to rely on the use of a parallel (or auxiliary or AC) compressor rack (in the middle in Figure 3.1), with the intent to remove the flash gas generated in the intermediate pressure liquid receiver. This solution identifies the 2nd generation and is the current benchmark for “CO₂ only” supermarket refrigeration units. Parallel compression technology is a promising expedient for “all-in-one” (or “fully integrated”) pure CO₂ systems in cold climate contexts (Karampour and Sawalha, 2017), besides representing the first step towards the use of transcritical R744 solutions in warm regions. Many studies on this solution can be found in the literature (Gullo et al., 2017b, 2017a, 2016b, 2016a; Karampour and Sawalha, 2015, 2017; Polzot et al., 2016a; Tsamos et al., 2017).

As a means to improve enormously the energy efficiency of pure CO₂ supermarket refrigeration systems, the multi-ejector concept can be adopted (Hafner et al., 2014a). The first R744 multi-ejector enhanced parallel compression installation (right-hand side in Figure 3.1) has been properly operating in a Swiss supermarket for many years (Hafner et al., 2014b). Such a technology was thoroughly investigated by many authors (Banasiak et al., 2015b, 2014; Fredslund et al., 2016; Gullo et al., 2017b, 2017a; Hafner et al., 2016, 2015, 2014b, 2014a; Hafner and Banasiak, 2016; Hafner, 2017; Haida et al., 2016a; Minetto et al., 2015a; Schönenberger, 2016). The results obtained suggest that a transcritical R744 parallel system supported by ejectors is the most efficient and eco-friendly option for the European commercial refrigeration sector.

Gullo et al. (2017b) showed that, compared to a conventional booster unit, the adoption of parallel compression can lead in theory to energy savings by 3.6% and 5.7% in Milan and Athens, respectively. In the same locations, the energy conservation achieved values of about 25% over the previously mentioned baseline. Also, the authors highlighted that approximately 22% of the energy could be spared with the aid of the multi-ejector concept in relation to parallel compression technology.

3.2 The multi-ejector concept

Any throttling valve operates (roughly) isenthalpically causing a drop in the refrigerating effect due to the conversion of the refrigerant kinetic energy generated by the pressure drop into friction. In order to recover part of this energy content, a two-phase ejector can be employed. Such a device features cheapness, the absence of moving parts, and the ability to handle two-phase flows with no damage. Bilir and Ersoy (2009) asserted that this solution is particularly promising for refrigerating applications operating in tropical countries and desert area. However, the enhancements in Coefficient of Performance (COP) achievable by adopting an ejector for work expansion recovery are strongly related to the select working fluid. On the one hand, in fact, the exergy destruction rates of the expansion valve belonging to the refrigeration unit using synthetic refrigerants (e.g. R134a and R410A) are usually low (Figure 3.2). On the other hand, these become enormous when it comes to R744 refrigerating systems. This is due to the occurrence of transcritical running modes, which entail massive differences between the rejection and absorption pressure (Figure 3.2). As a consequence, greater opportunities in terms of energy efficiency improvement are offered, as the recoverable expansion work is much higher than for conventional working fluids, especially with rise in hot sink temperature. According to Lawrence and Elbel (2015), in fact, the CO₂ ejector efficiency (defined in accordance with the one proposed by Elbel and Hrňjak, 2008) ranges from 0.2 to 0.3, whereas the high-GWP ejector efficiency is usually below 0.2. This means that 20%-30% of the expansion work, which is generally dissipated, is used to increase significantly the compressor suction pressure.

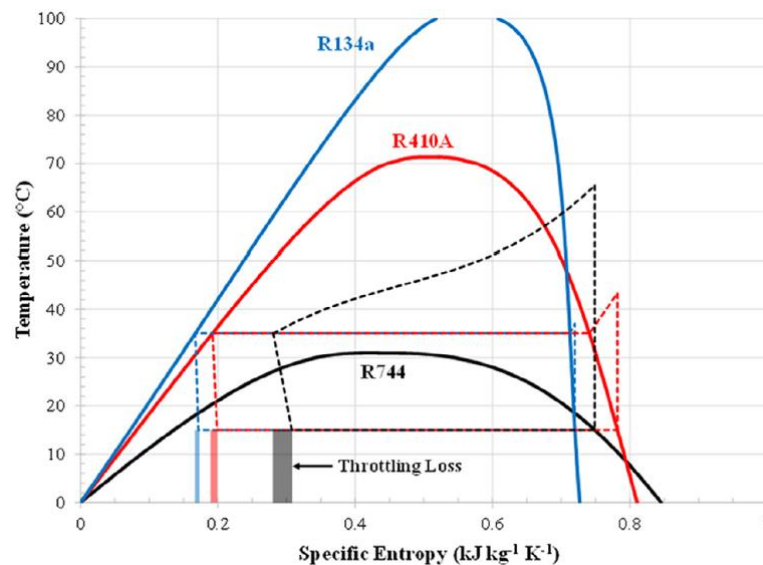


Figure 3.2 Throttling losses related to a vapour-compression refrigeration system using R744, R134a and R410A in a T-s diagram (Elbel and Lawrence, 2016).

It is important to highlight that a single constant-geometry ejector is not able to control precisely the discharge pressure, which plays a crucial role when it comes to attaining a relevant energy efficiency for transcritical CO₂ systems (Ge and Tassou, 2011b). Either an adjustable needle-based ejector or the multi-ejector concept can be adopted to achieve such objective more appropriately. The former implies that an unsatisfactory ejector efficiency is obtained over a broad operation range. In order to take steps towards this gap, Hafner et al. (2014a) introduced the multi-ejector concept. According to Banasiak et al. (2015b), in fact, a multi-ejector module is able to control the heat rejection pressure and, simultaneously, to recover expansion work more suitably than an individual fixed-geometry ejector. This technology relies on various devices of different sizes and connected in parallel. Therefore, the number of employed ejectors is constantly varied so as to match the required capacity in any operation condition. In particular, a multi-ejector block consists of usually 4-6 vapour ejectors and generally 2 liquid ejectors. The vapour ejectors are used to pre-compress a large amount of the refrigerant, implying that the suction pressure of parallel compressors is substantially higher than that of medium temperature (MT) compressors. As a consequence, the higher the outdoor temperature, the more unloaded the MT compressors and thus the more significant the energy savings obtained. On

the other hand, the liquid ejectors are devoted to recirculate some liquid back to the evaporators to eliminate the dry-out phenomenon and increase their corresponding operating temperature. Haida et al. (2016b) investigated two liquid ejectors of different size belonging to a multi-ejector module. Girotto (2017) claimed that a liquid ejector featuring an efficiency of 8% permits improving the global yearly performance by 15%, whereas a vapour ejector with a peak efficiency of 30% increases the overall annual performance by 5%. This is due to the significant $\Delta p/\Delta t$ ratio and the extremely favourable heat transfer performance of R744, which imply that the superheating is particularly detrimental to transcritical CO₂ refrigeration solutions. As a consequence, the possible replacement of the conventional dry-expansion evaporators with overfed heat exchangers would lead to substantial energy savings on the part of such systems. It was found that overfed evaporators have an operating temperature 6 K and 8 K higher than MT and LT dry-expansion evaporators respectively (Hafner et al., 2014b; Hafner and Banasiak, 2016; Schönerberger, 2016). As additional energy benefits, this allows to reduce the frost formation and number of defrost cycles with respect to a conventional system (Hafner et al., 2014b; Hafner and Banasiak, 2016; Schönerberger, 2016). Furthermore, Minetto et al. (2014a) estimated that the use of liquid ejectors would yield a decrease in the compressor energy consumption by approximately 13% with respect to a conventional configuration (the assessment was based on an outdoor temperature of roughly 16 °C and an air temperature of about 0 °C). Compared to a R404A-unit, Gullo et al. (2016b) assessed a reduction in annual energy consumption ranging from 8.2% (in Seville) to 12.3% (in Rome) by using MT overfed evaporators and parallel compression.

The reliability and the manufacturability of a multi-ejector module have already been verified, and its control system has already been efficaciously put in practice (Banasiak et al., 2015b; Banasiak et al., 2014; Hafner et al., 2016; Hafner et al., 2014b; Schönerberger, 2016). Banasiak et al. (2015b) implemented the design, the manufacturing and the performance mapping of a multi-ejector rack for commercial refrigeration purposes. Hafner et al. (2014b) suggested that such a solution leads to an energy saving of 12% over the technology based on parallel compression in a Swiss store. The multi-ejector concept permits increasing the system efficiency up to 30% in relation to a conventional booster unit, particularly at high external temperatures (Hafner et al., 2014a). A multi-ejector based configuration operating in a food retail located in Bari (Italy) consumes 22.5% less electricity than a conventional one-stage CO₂ refrigerating unit (Minetto et al., 2014b). Haida et al. (2016a) experimentally revealed that a multi-ejector R744 refrigerating system enhances the COP by 7% compared to a R744 unit employing parallel compression. With the aid of multi-ejector concept, energy savings between 15% and 25% in relation to a R744 refrigeration unit with parallel compression in two Swiss supermarkets were estimated by Schönerberger (2016). The author pointed out that the results are strongly depending on the heat need, the application and the weather conditions. The field measurements collected by Fredslund et al. (2016) from various supermarkets brought to light that, similarly to what has been evaluated in the laboratory, vapour ejector efficiencies above 0.25 are achievable. Also, drops in the energy consumption ranging from 10% to 15% at the external temperature of approximately 30 °C were assessed for a solution with and without coupling with the AC unit, respectively. Gullo et al. (2017a) showed that, theoretically, a “CO₂ only” system equipped with a multi-rack block in a supermarket of average size located in Mediterranean Europe leads to energy savings of 20-25% compared to a R404A direct expansion unit. The theoretical assessment by Gullo et al. (2017b) highlighted that the multi-ejector concept permits achieving a fall in the energy consumption by 31.8%÷37.1% in a cold climate context (i.e. Oslo), 17.9%÷33.6% in mild climates (i.e. Frankfurt, Milan) and 19.9%÷24.6% in warm places (i.e. Athens) compared to an R404A unit. With respect to real applications, a hypermarket using this technology was open in Timisoara (Romania) in 2015. The usage of a multi-ejector arrangement combined with the heat recovery implementation and the DHW production are supposed to lead to a reduction in the energy consumption of up to 13% in relation to a solution with parallel compression (Frigo-Consulting LTD, 2015). According to Girotto (2017), today approximately 50 supermarkets relying on the multi-ejector concept have been installed.

The multi-ejector block and its main components are showed in Figure 3.3. Up to 6 ejectors (2), activated by a conventional coil (3), are hosted within the multi-ejector block (1). The gas cooler/condenser is connected to port 4, whereas the suction of the refrigerants occurs through port 5. Port 6 is used for discharging the total amount of refrigerant, while the sensors (7) for each port measure the pressure. Besides the aforementioned energy advantages, Girotto (2017) highlighted that many others can be related to the usage of multi-ejector concept, such as reduction in the discharge temperature, a simplified control of evaporators, etc.

It is worth highlighting that some energy benefits can also be attained by employing an expander as a substitute for the conventional expansion valve. However, this presents the same complexity and high cost of compressors, besides being easily damageable owing to the presence of a large amount of liquid.

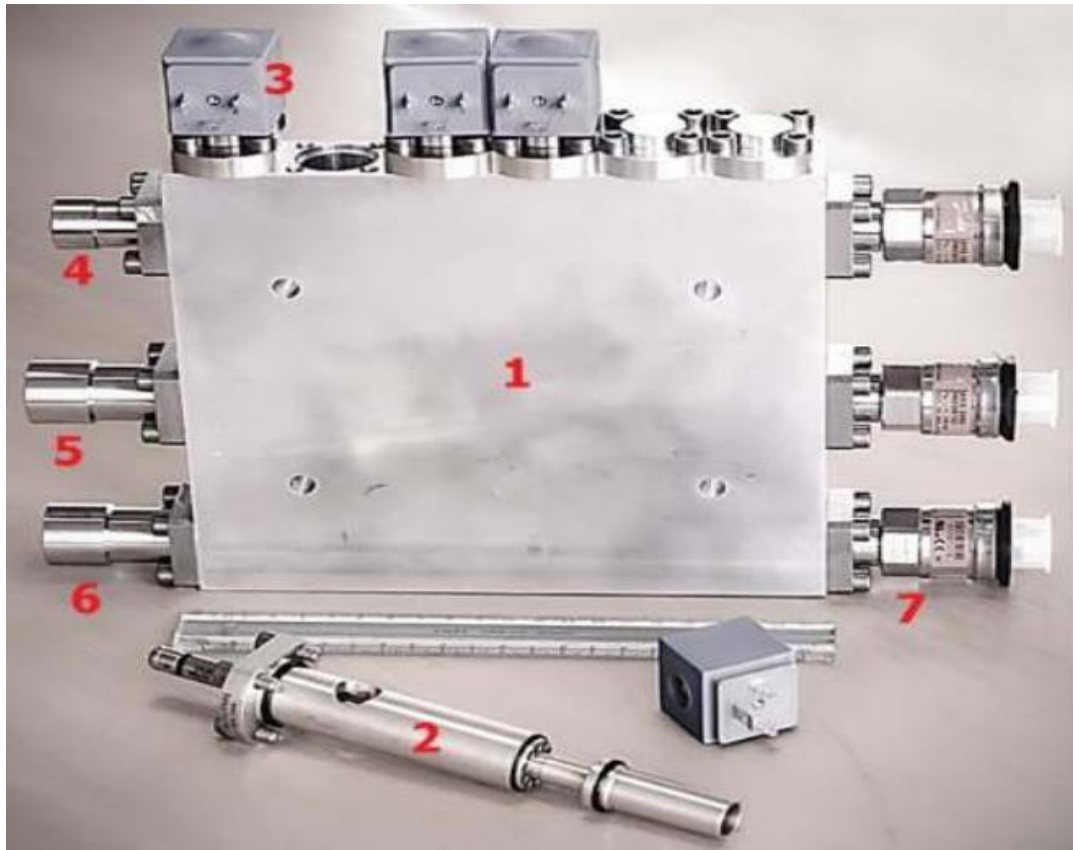


Figure 3.3 Multi-ejector block and its main components (Hafner and Banasiak, 2016).

3.3 “All-in-one” concept

The refrigeration unit is responsible for the largest share of electricity (i.e. roughly 33%) in a supermarket (Cecchinato et al., 2010). Other additional significant consumptions, i.e. about 20% of the total electricity consumption, are owing to heating and air-conditioning demands (Cecchinato et al., 2010; Hafner et al., 2014a). As suggested by Hafner et al. (2015), an expedient to reduce the cost related to all these needs is the so-called “all-in-one” (or “fully integrated”) concept. This is expected to reduce enormously the total investment, maintenance and running costs associated with transcritical CO₂ refrigeration systems for supermarket applications, especially the ones located in warm places. Karampour and Sawalha (2015) defined the technologies applying this concept as standard in the current food retail industry. “All-in-one” units are capable of providing the whole air-conditioning (AC), refrigeration and DHW reclaims, besides meeting most of or even the entire heating need of the selected supermarket.

The solution sketched in Figure 3.4 represents an “all-in-one” transcritical R744 refrigerating solution for food retails located in Mediterranean Europe. The multi-ejector concept permits overfeeding the MT overfed evaporators, whose operating pressure is around 33 bar (i.e. $t_{MT} = -2\text{ °C}$) rather than about 28 bar (i.e. $t_{MT} = -8\text{ °C}$) as for dry-expansion heat exchangers. The low evaporating pressure related to low temperature (LT) display cabinets and LT cold storage rooms, which also operate with no superheating (i.e. overfed evaporators), is kept at about 17 bar with the aid of the LT compressors. The liquid coming out of these evaporators is then collected in the accumulator located upstream of the LT compressors. The working fluid exiting the LT compressors is generally de-superheated before being drawn by the parallel compressors. Also, the operation time of the AC compressors can be extended by linking the LT to them. The resulting increase in the annual operating time of the auxiliary compressors allows to increase the energy advantages related to their use and to decrease the maintenance issues, as pointed out by Minetto et al. (2014b). To avoid high installation cost and improve the compactness of the refrigeration packs with various annual cooling

demands of various suction groups, the compressor suction towards the different suction groups needs to be modified according to the operation conditions. Depending on the status of the on/off valve upstream of the compressors, these are either connected to the MT- or AC-suction. This leads to a “gap-free” control of the cooling capacity over a wide running range. As regards the solution sketched in Figure 3.4, only one compressor is connected directly to the AC and MT suction group. The heat recovery and rejection part consist of two different sections. The gas cooler on the right-hand side in Figure 3.4, which is used in summertime, can be by-passed in order to provide the required amount of DHW and/or space heating. The section on the left-hand side in Figure 3.4 is employed in more extreme operation conditions (i.e. coldest and hottest days of the year). This features an exterior heat exchanger (HX) as an additional heat source in heating mode to provide the whole heating demand even in case of limited internal loads. The whole amount of the refrigerant coming out of this heat exchanger is then drawn by the AC multi-ejector module. On the other hand, the exterior heat exchanger performs as a gas cooler for the parallel compressors in AC mode. As shown in Figure 3.4, the water of the fire water tank can be used as an auxiliary heat sink to further reduce the temperature of CO₂ in the high-pressure side at high outdoor temperatures. The temperature of such a tank can be dropped with the aid of a dry cooler at night. Also, the simultaneous usage of the ice-water cooling evaporators (at the bottom left-hand side in Figure 3.4) and that of the AC multi-ejector rack permits the parallel compressors to have a high suction pressure. The first evaporator interacts with a separator tank at 42 bar (i.e. about +7 °C). The refrigerant, which is provided by gravity, allows to cool down the working fluid at 12 °C returning from the building. On the other hand, the second evaporator allows to bring the temperature of the working fluid further down to 7 °C as more cooling capacity is necessary. Thus, the AC multi-ejector block draws the vapour from the second evaporator and the entire amount of the refrigerant is discharged into the separator related to the AC compressors.

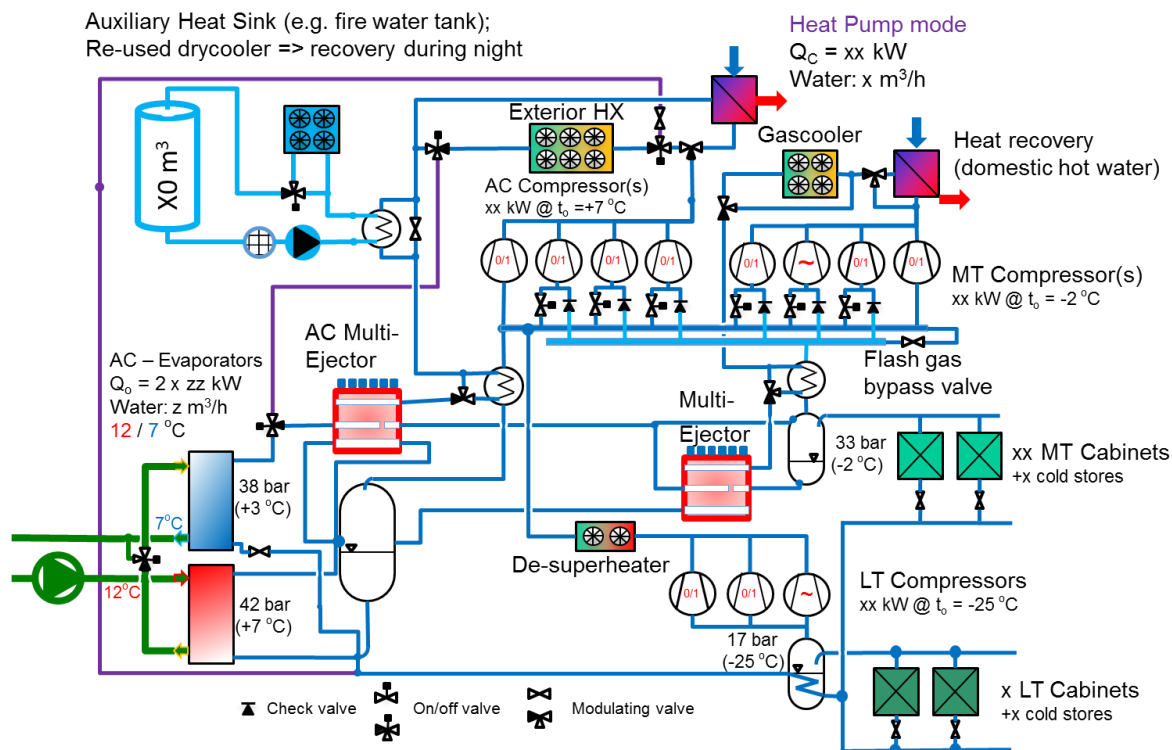


Figure 3.4 Fully integrated CO₂ refrigeration system for supermarkets located in Southern European locations with LT and MT cooling loads, hot water demand, heating & cooling demand for the building and an auxiliary heat sink (Hafner, 2017).

Also, it is worth remarking that the solution equipped with the multi-ejector rack guarantees a significant level of safety. In fact, in case of failure of the auxiliary compressors, the flash gas can be removed from the intermediate pressure liquid receiver by employing a vapour by-pass valve. In addition, in the event of the possible malfunction of the liquid ejectors or a reduced amount of liquid, the evaporators can be switched to the superheated mode in any

operating conditions. Furthermore, the system is also equipped with conventional expansion valves downstream of the gas cooler in order to, if it is necessary, substitute (or simply work in parallel with) the vapour ejectors. Moreover, the auxiliary compressors can always take over the MT compressors. Finally, the presence of the separator at medium pressure and that of both a low pressure receiver downstream of the LT evaporators and the internal heat exchanger prevent the corresponding compressors from drawing any liquid.

The usage of water as the energy carrier implies that many heat exchangers need to be adopted with a consequent deterioration in the overall efficiency of AC and heating units. The problems related to water corrosiveness can be avoided by adopting suitable precautionary measures (i.e. water/inhibitor mixture), which lead to overall performance worsening. Also, a large amount of the total investment cost is owing to the water circuit. These drawbacks can be overcome by using R744 for direct cooling and heating fan coils installed inside the store, as the represented in Figure 3.5. A similar approach can also be adopted for the air curtains. As a consequence, no space for water tanks and pumps is necessary and the total cost of the heating and cooling equipment can be decreased. Also, heating, ventilation and air-conditioning (HVAC) units can be more quickly installed. On the other hand, close attention has to be paid to both the high operating pressures present inside the public part of the building and the applied heat exchanger coil design (i.e. design for dual operation).

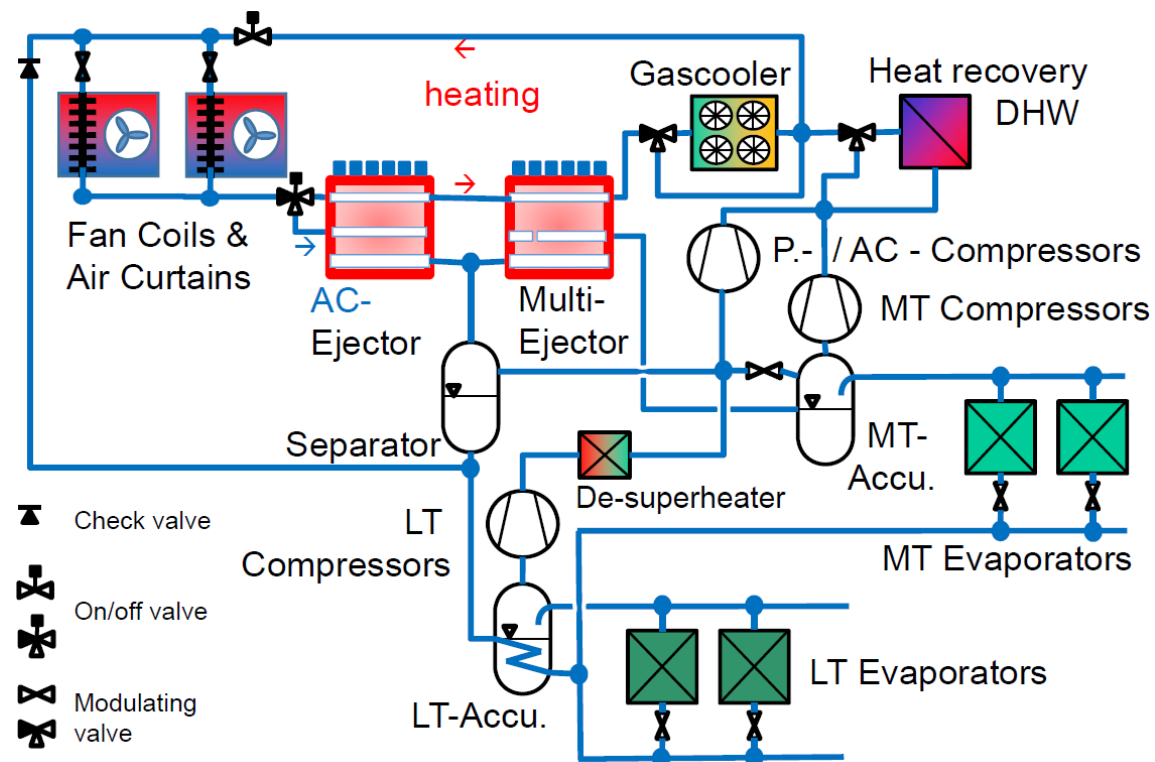


Figure 3.5 Integration of direct heating and cooling fan coils and air curtains in CO₂ commercial refrigeration units equipped with AC multi-ejector module.

In Figure 3.6 and Figure 3.7 two different solutions with no multi-ejector block dedicated to AC units are represented. In AC mode the expansion valves upstream of the fan coils and air curtains are employed for suitably feeding these units operating as evaporators, as sketched in Figure 3.6. On the other hand, in heating mode fan coils and air curtains are used for directly rejecting some heat into the building and the gas cooler is by-passed. In the more advanced layout shown in Figure 3.7 the multi-ejector rack recovers some expansion work also as AC mode occurs.

As the “all-in-one” and multi-ejector concepts are relatively new, few field measurements are still available in the open literature. Hafner et al. (2016) collected some data from a refrigeration system operating in a food retail located in Spiazzo (Northern Italy) at outdoor temperatures between 22 °C and 35 °C. The energy consumption was found to fall from 15% to 30% compared to the configuration with parallel compressor, besides providing the whole AC demand

of the store. The outcomes strongly depended on both the AC need and the external temperature. In case of integration with the AC unit, a R744 ejector supported parallel system consumes from 16.6% to 26.2% less electricity than a separated HFC arrangement depending on the size of both the AC system and the supermarket, as well as on the selected locations, as theoretically shown by Gullo et al. (2017a). As for real applications, Italy's largest hypermarket (10000 m²) started recently operating in Milan employing an "all-in-one" CO₂ configuration with multi-ejector arrangement (Danfoss, 2016). Thanks to this technology as well as an integrated control of HVAC, light and refrigeration, the energy savings are expected to be around 50%.

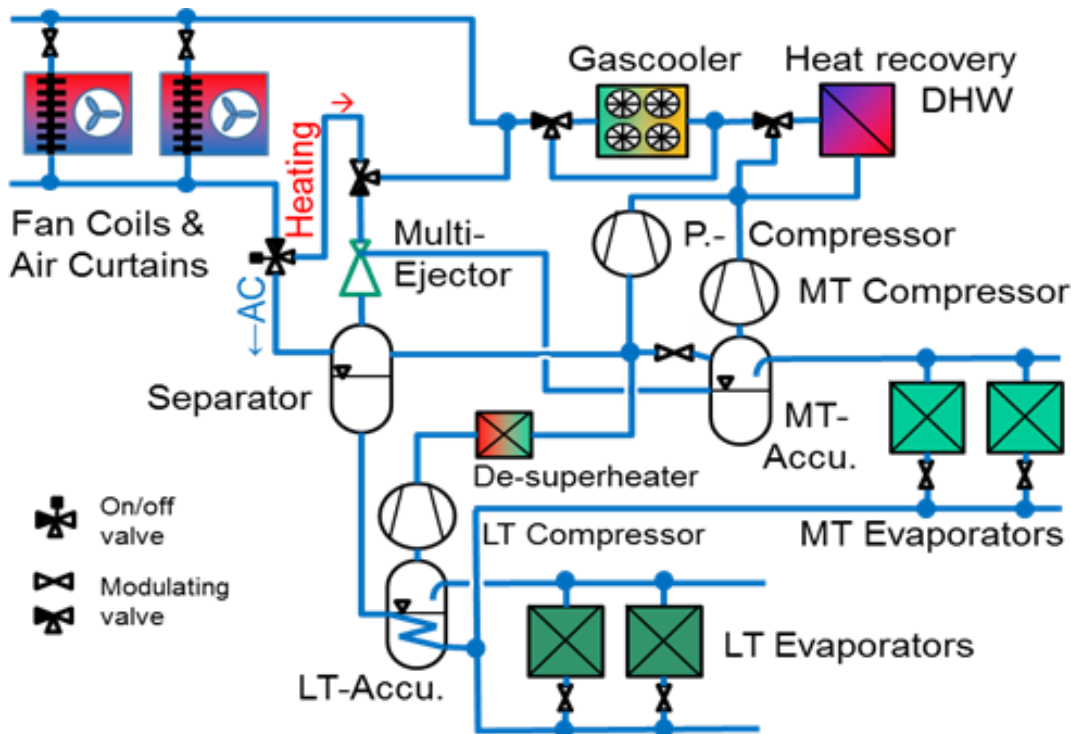


Figure 3.6 Integration of direct heating and cooling fan coils and air curtains in CO₂ commercial refrigeration units (ejector partly by-passed during AC) (Hafner, 2017).

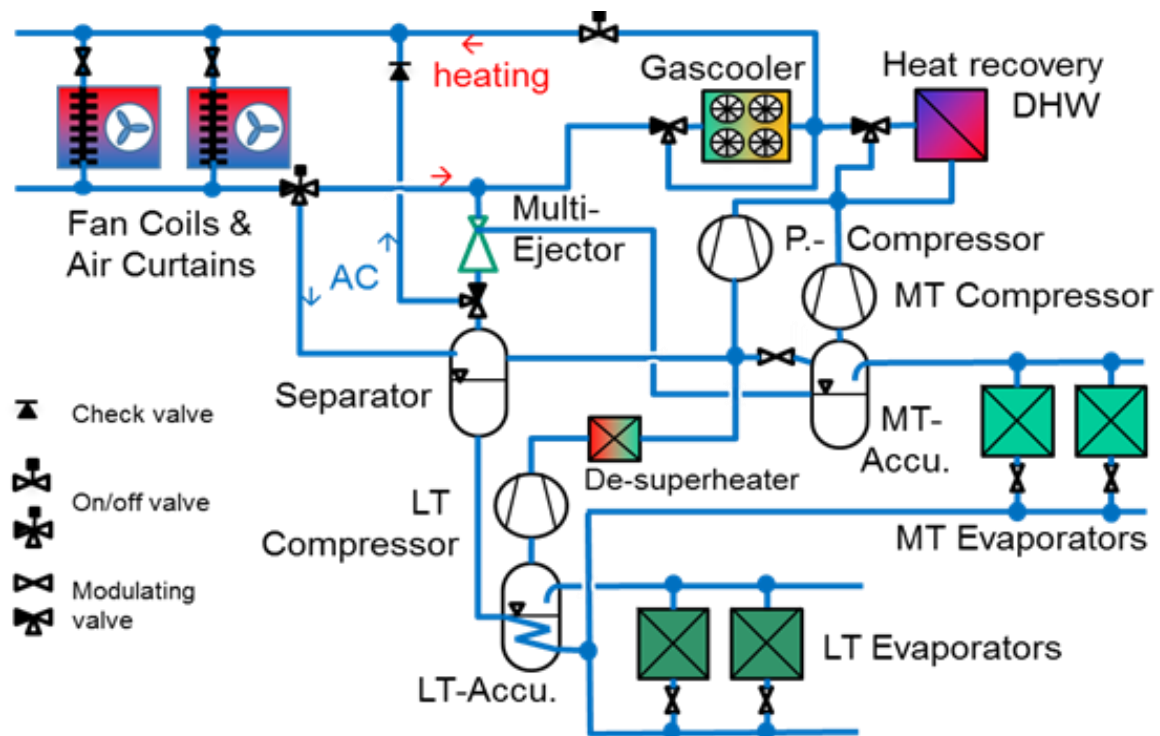


Figure 3.7 Integration of direct heating and cooling fan coils and air curtains in CO2 commercial refrigeration units (ejector utilized also during AC) (Hafner, 2017).

4 REVERSIBLE HEAT PUMPING APPLICATIONS

The great improvement of the living standards in the developed countries and the rapid growth in the last few years of some developing ones have considerably promoted the spread of reversible heat pump systems. By means of such solutions, in fact, different human needs can be satisfied, such as food preservation, thermal comfort, domestic hot water production, etc. (Hafner, 2015).

Figure 4.1 depicts the final energy consumption by sector, highlighting that in the EU the households, services, etc., feature higher total energy consumption than industrial and transport sectors due to the large requirements for space heating and hot water production. Also, Jakobs et al. (2010) claimed that food and chemical processes are the main users of energy in Italy, which implies that large amounts of water up to 100 °C are required.

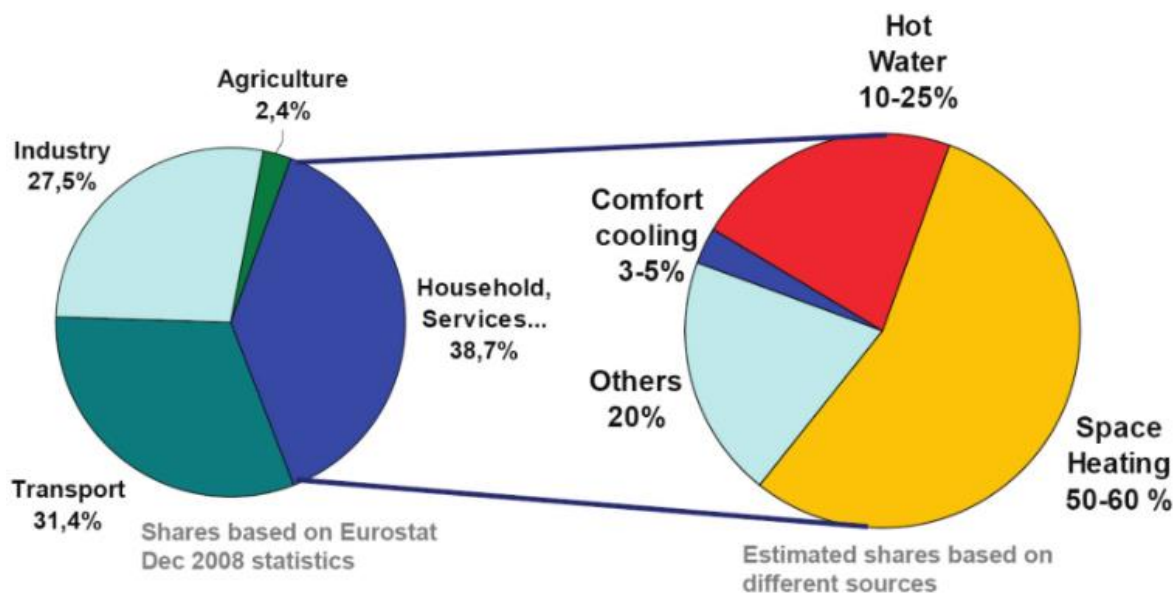


Figure 4.1 Final energy consumption by sector in European Union (Jakobs et al., 2010).

Also, some sectors, such as multi-family residential and office buildings, food preservation sector, dairies, etc., have noteworthy concurrent needs of warm water, hot water and cooling. In food processing, working fluids in the range 25 °C÷95 °C for heating reclaims and 0 °C÷15 °C for cooling needs are simultaneously required, causing large electricity consumptions. In these applications, a R744 heat pump can efficiently operate as a stand-alone system to cover the DHW needs (for hotels, gyms, hospitals, etc.) in combination with separate solutions for space heating and cooling demands or as an integrated unit. The latter is a more cost-effective option thanks to its lower investment and installation costs related to its compact design. It is worth remarking that the sector of both air-conditioning and heating unit for residential and commercial buildings is still widely dominated by HFC-based reversible heat pumps, leading to massive contributions to climate change. The number of CO₂ heat pumping technologies for hot water production almost doubled from 2010 to 2011 in Europe. This was due to two main causes:

- the ever-stricter European building codes and regulations, whose adoption caused a great reduction in heating demand and a noteworthy interest in sanitary hot water needs. Furthermore, water-heating heat pumps can be easily combined with renewable energy sources to achieve an additional reduction in the required primary energy consumption of the building;
- openness of the European market to Japanese manufacturers, which are the current world leaders in DHW CO₂ heat pumps. It was found that COPs up to 5.1 can be accomplished by heating water from 16 °C to 65 °C at the external temperature of 24 °C (Hashimoto, 2006).

Adriansyah (2001) suggested the use of R744 heat pump installations to meet both the water heating and the air-conditioning demands of large hotels in hot climates, whose contributions to their total energy consumption are respectively equal to 44% and 19% (Figure 4.2).

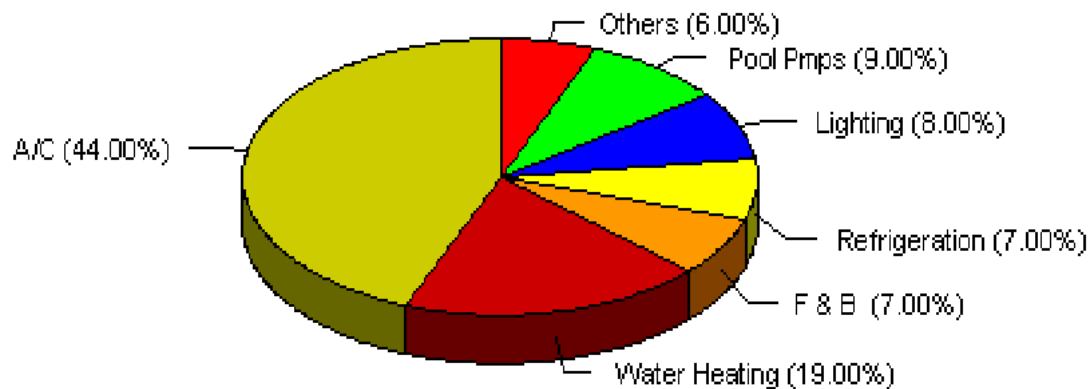


Figure 4.2 Breakdown of the energy consumption in a typical large hotel (< 100 rooms) in hot climates (Adriansyah, 2001).

According to Nekså (2002), an air-water CO₂ heat pump unit consumes 75% less energy than electrical or gas-fired systems to produce tap water at 60 °C. Also, the author pointed out the R744 as a promising working fluid for space heating applications. Byrne et al. (2009) designed and compared the performance of an improved R744 heat pump unit for simultaneous heating and cooling with that of the same heat pump system using R407C for hotels, luxury dwellings and small offices. The results showed that the improved CO₂ heat pump consumes respectively about 4% more energy than the improved R407C heat pump and 13.2% less electricity in comparison with a standard heat pump in a hotel located in Paris (France). As for the outcomes in terms of TEWI, reductions from 4.2% up to 15.7% were estimated. As suggested by Calabrese et al. (2015), the rooftop heat pump solutions represent an encouraging technology for the air conditioning of large buildings and shopping centres. However, the evaluation carried out by these authors revealed that such a configuration could achieve lower COPs than HFC-based heat pumping units in heating mode, especially at air temperatures above 16 °C.

It is a well-known fact that high temperatures of the cooling medium and low temperature glide at the gas cooler side, operating conditions which can be commonly reached in cooling and heating modes, favour other working fluids over R744. Therefore, similarly to CO₂ refrigeration systems operating in warm regions, the success on the part of transcritical R744 heat pump technologies in Southern European market for high-consumptive buildings is strongly related to:

- the use of solutions for simultaneous heating and cooling applications;
- the identification of an expedient capable of increasing the energy savings of such systems substantially.

Both aspects will lead to solutions extremely (energetically and economically) competitive with the ones currently used. This goal can be accomplished with the aid of the multi-ejector concept, as suggested by Hafner et al. (2014a). In fact, the author claimed that the multi-ejector technology is the most suitable solution for any “CO₂ only” application featuring a high refrigerant return temperature, such as heat pumps for space conditioning and high water temperatures.

The optimum geometry of an ejector belonging to an R744 heat pump with a small capacity was experimentally and numerically investigated by Banasiak et al. (2012). A maximum growth in COP by 8% was obtained in comparison with a cycle using a conventional expansion device. Minetto et al. (2013) experimentally mapped the performance of a CO₂ heat pump for domestic space heating and air-conditioning and employing an ejector for expansion work recovery. According to the experimental results collected by Banasiak et al. (2015a), the mass flow rate of the primary fluid is significantly affected by the inlet temperature and inlet pressure, which also influences the pressure lift (i.e. pressure difference between the diffuser and the evaporator) substantially. The adoption of an ejector as an expansion work device allows a CO₂ heat pumping to equal the energy consumption of a R410A unit, as demonstrated by Minetto et al. (2016). The authors did not take into account the benefit of the ejector for the tap water heating. The system

schematized in Figure 4.3 and Figure 4.4 and used for air-conditioning and space heating applications in Northern Italy results in an annual energy saving of about 15% over a conventional solution (Minetto et al., 2015b).

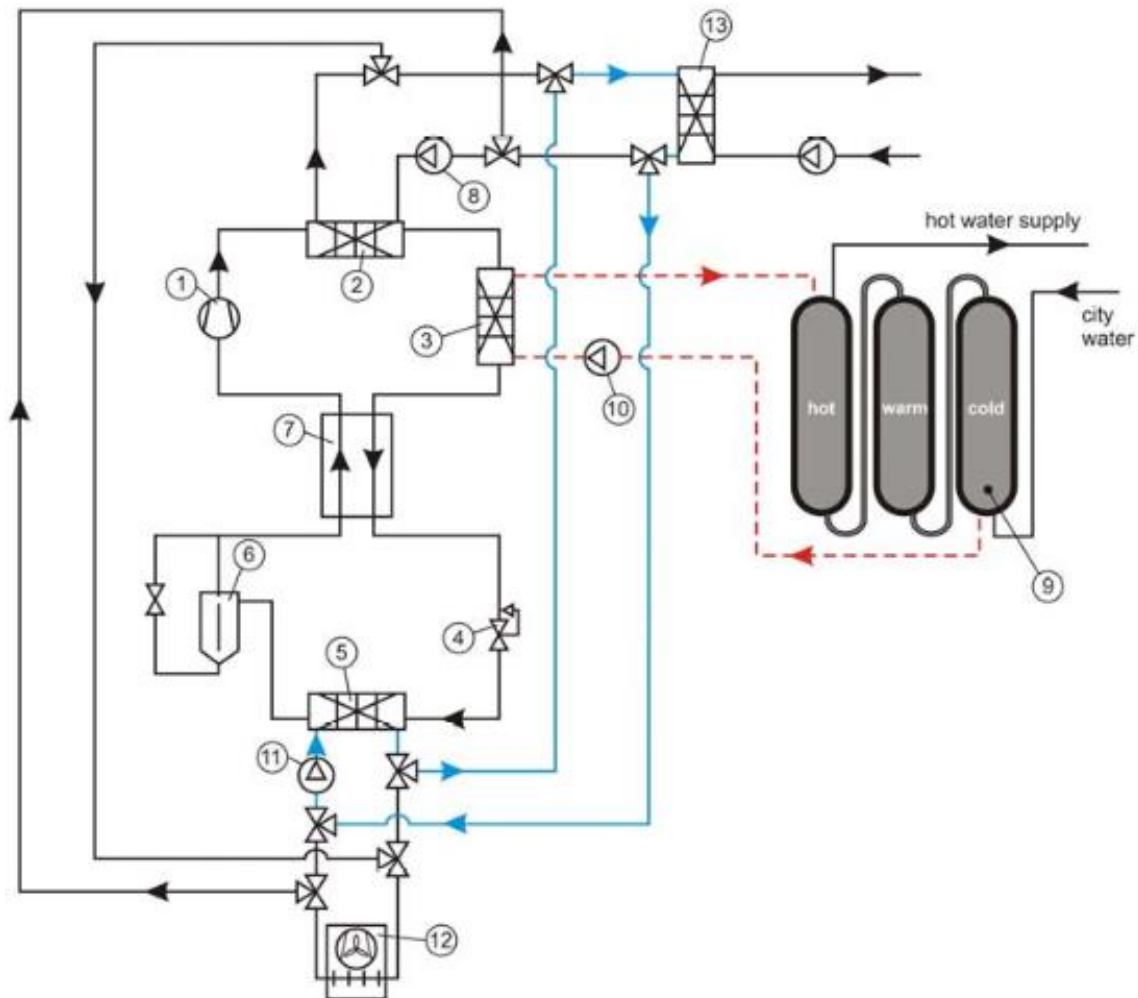


Figure 4.3 Schematic of a R744 heat pump system for tap water heating and equipped with an ejector (Minetto et al., 2015b).

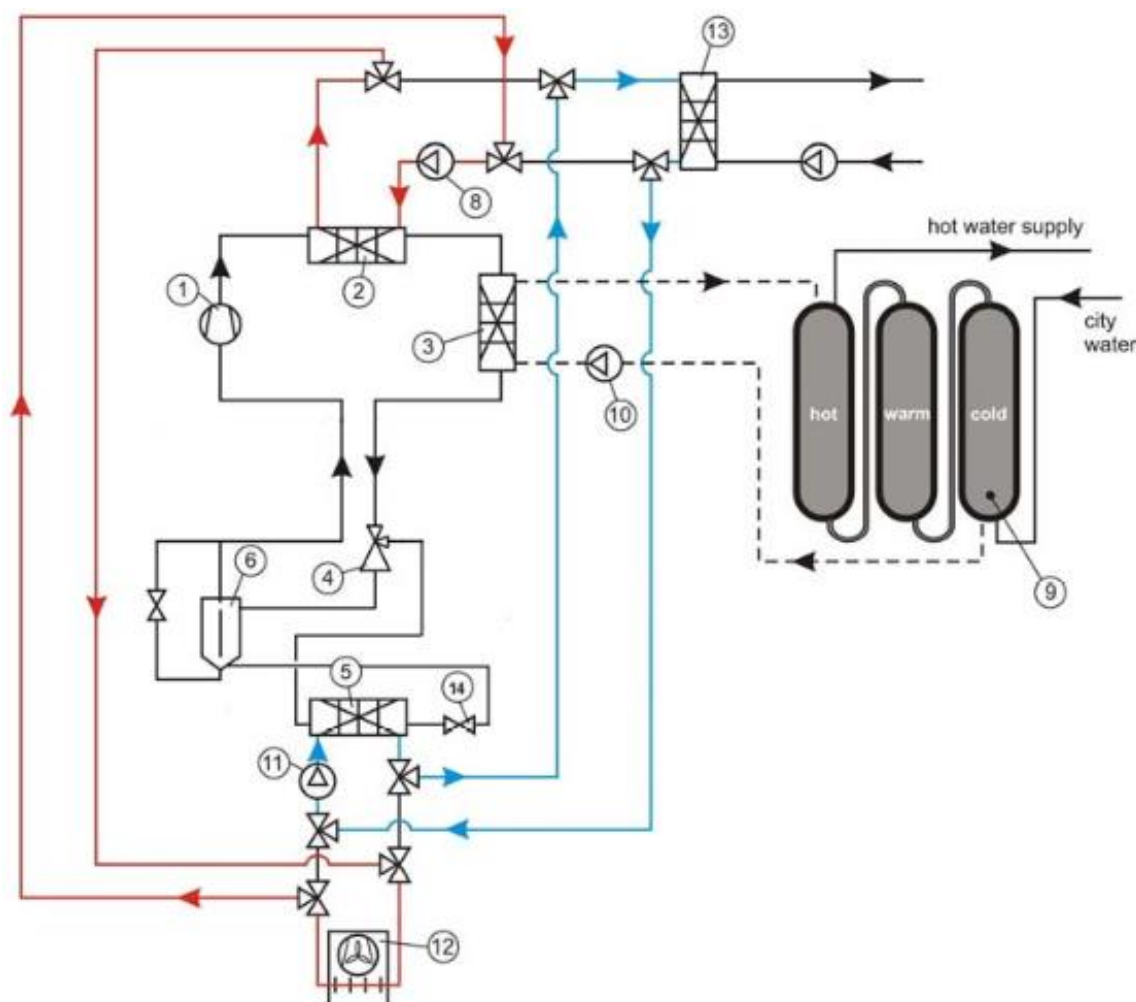


Figure 4.4 Schematic of a R744 heat pump system for space cooling and equipped with an ejector (Minetto et al., 2015b).

As regards the R744 heat pump units based on the multi-ejector, Boccardi et al. (2016) made an experimental performance comparison between a basic and a regenerated “CO₂ only” air-to-water heat pump system with an expansion valve. The authors concluded that further investigation on multi-ejector based units for air-conditioning applications are needed. At a later time, Boccardi et al. (2017) experimentally implemented a sensitivity analysis for a transcritical CO₂ heat pump solution outfitted with a multi-ejector module with respect to the ejector area ratio, compressor frequency (30 Hz ÷ 60 Hz) and outdoor temperature (i.e. -15 °C ÷ 12 °C). The outcomes revealed that the optimal performance of the ejector does not occur at the best performance in relation to COP and heating capacity. This entails that such a solution can still be significantly enhanced as the ejector design is more accurately assessed. The investigations by Boccardi et al. (2016, 2017) suggest that it is still necessary to properly transfer the current knowledge regarding multi-ejector R744 supermarket refrigerating plants to reversible heat pumping systems. In addition, the energy, economic and environmental advantages associated with the adoption of this solution over HFC-based systems still need to be exhaustively proved. This target has to be achieved with the aid of both laboratory data and field measurements in order to remove all the technological and non-technological barriers and raise the confidence in multi-ejector based CO₂ solutions. This would allow to promote and sustain the diffusion of such systems, especially in high-demanding buildings located in warm regions for which the achievable energy, economic and environmental savings are expected to be even more emphasised. As a final remark, the advantages related to the integration of direct heating and cooling fan coils and air curtains on the part of reversible R744 heat pumping units also need to be assessed, especially when it comes to the aforementioned applications.

5 CONCLUSIONS AND FUTURE WORK

Under the pressure of an ever-growing eco-friendly attitude as well as of ever-strict legislative acts, transcritical CO₂ supermarket refrigerating systems in Europe have experienced tremendous technological developments since the revival of this refrigerant around 1990. Also, these technologies presented an increase in energy efficiency up to 25% and a drop in their equipment cost by 30% between 2008 and 2016 (Shecco, 2016). Further falls in cost are supposed to be obtained by adopting “fully integrated” solutions in relation to HFC-based systems. Consequently, the market share of the multi-ejector based R744 supermarket refrigeration systems is expected to be equal to 50%-80% for new installations in 2020 (Hafner, 2015).

As presented in this work, the available theoretical and experimental results have revealed that multi-ejector concept is continuously pushing the so-called “CO₂ equator” southwards as regards supermarket applications. This energy efficiency limit was located in the northern shore of the Mediterranean in 2013 (Shecco, 2016). Also, this technology is already being commercialized with great results even in warm regions. On the other hand, a remarkable brake on the full penetration of such HFC-free technologies into European market, especially with respect to Mediterranean region, is put by some remaining non-technological barriers, such as the shortage of trained installers and service technicians, and the lack of confidence in such solutions. As regards reversible R744 heat pumping units, the current situation is even more dramatic. This is because, besides the presence of the aforementioned barriers, the multi-ejector concept still needs to be properly transferred from commercial refrigeration applications. In order to overcome these drawbacks, MultiPACK was established in October 2016. MultiPACK is a European project funded under the Horizon 2020 Research and Innovation Programme (Grant Agreement number: 723137). This project aims at building confidence in integrated heating, ventilation, air-conditioning and refrigeration (HVAC&R) packages based on the CO₂ technology, as an alternative to F-gases, installed in high energy-demanding buildings. The introduction of these new energy-efficient units, in addition to complying with EU regulations and reducing the impact on the environment, should decrease the specific energy consumption by more than 25% compared to HFC-based systems, while also reducing the total cost of ownership. Confidence will be built by running demonstration tests at six commercial sites at no expense for the owners. The principal target is Mediterranean Europe, where the warm climate constitutes a significant challenge for heat pumping and refrigeration technologies. During the project the performance, durability and reliability of reversible HVAC & DHW (heating, ventilation and air-conditioning & domestic hot water) CO₂ packs including multi-ejector blocks and thermal storage modules will be assessed, to secure the technological maturity of the packaged units by providing maximum possible modularity and scalability, as well as remote monitoring and control. Furthermore, MultiPACK also aims at refining the design and control of multi-ejectors according to the specifics of end-users, as well as evaluating the performance, durability and reliability of multi-ejector blocks. Similar verifications will be performed with respect to integrated supermarkets packs.

6 NOMENCLATURE

Symbols, abbreviations and subscripts/superscripts

AC	Air-conditioning
COP	Coefficient of Performance [-]
DHW	Domestic hot water
GWP	Global warming potential [$\text{kg}_{\text{CO}_2, \text{equ}} \cdot \text{kg}_{\text{refrigerant}}^{-1}$]
HFC	Hydrofluorocarbon
HFO	Hydrofluoroolefin
HP	Heat pump
HVAC	Heating, ventilation and air-conditioning
HVAC&R	Heating, ventilation, air-conditioning and refrigeration
HX	Heat exchanger
LT	Low temperature
MT	Medium temperature
p	Pressure [bar]
\dot{Q}_0	Cooling capacity related to air-conditioning unit [kW]
\dot{Q}_c	Heat capacity for space heating [kW]
t	Temperature [°C]

Greek symbols

Δ	Difference
----------	------------

7 REFERENCES

- Adriansyah, W., 2001: '*Combined Air-conditioning and Tap Water Heating Plant, Using CO₂ as Refrigerant for Indonesian Climate Condition*', [Ph.D. dissertation]. Trondheim, NTNU Norwegian University of Science and Technology – Available at: <<http://ntnu.diva-portal.org/smash/get/diva2:123925/FULLTEXT01.pdf>> [accessed 19.07.2017].
- Banasiak, K., Hafner, A., Kriezi, E. E., Madsen, K. B., Birkelund, M., Fredslund, K., Olsson, R., 2015: '*Development and performance mapping of a multi-ejector expansion work recovery pack for R744 vapour compression units*', International Journal of Refrigeration 57, 265-276. DOI: [10.1016/j.ijrefrig.2015.05.016](https://doi.org/10.1016/j.ijrefrig.2015.05.016)
- Banasiak, K., Hafner, A., Eikevik, T. M., 2015a: '*Experimental characteristics of R744 ejectors for expansion work recovery in heat pumping installations*', Proceedings of the 24th IIR International Congress of Refrigeration, 16th - 22nd August; Yokohama, Japan. ID: 178.
- Banasiak, K., Hafner, A., Haddal, O., Eikevik, T., 2014: '*Test facility for a multiejector R744 refrigeration system*', Proceedings of the 11th IIR Gustav Lorentzen Conference on Natural Refrigerants, 31st August - 2nd September; Hangzhou, China. ID: 70.
- Banasiak, K., Hafner, A., Andresen, T., 2012: '*Experimental and numerical investigation of the influence of the two-phase ejector geometry on the performance of the R744 heat pump*', International Journal of Refrigeration 35(6), 1617-1625. DOI: [10.1016/j.ijrefrig.2012.04.012](https://doi.org/10.1016/j.ijrefrig.2012.04.012)
- Bilir N., Ersoy H. K., 2009: '*Performance improvement of the vapour compression refrigeration cycle by a two-phase constant area ejector*', International Journal of Energy Research 33, 469–480. DOI: [10.1002/er.1488](https://doi.org/10.1002/er.1488)
- Boccardi, G., Botticella, F., Lillo, G., Mastrullo, R., Mauro, A. W., Trincerì, R., 2017: '*Experimental investigation on the performance of a transcritical CO₂ heat pump with multi-ejector expansion system*', International Journal of Refrigeration (In Press, Accepted Manuscript). DOI: [10.1016/j.ijrefrig.2017.06.013](https://doi.org/10.1016/j.ijrefrig.2017.06.013)
- Boccardi, G., Botticella, F., Lillo, G., Mastrullo, R., Mauro, A. W., Trincerì, R., 2016: '*Thermodynamic Analysis of a Multi-Ejector, CO₂, Air-To-Water Heat Pump System*', Energy Procedia 101, 846-853. DOI: [10.1016/j.egypro.2016.11.107](https://doi.org/10.1016/j.egypro.2016.11.107)
- Byrne, P., Mirel, J., Lenat, Y., 2009: '*Design and simulation of a heat pump for simultaneous heating and cooling using HFC or CO₂ as a working fluid*', International Journal of Refrigeration 32(7), 1711-1723. DOI: [10.1016/j.ijrefrig.2009.05.008](https://doi.org/10.1016/j.ijrefrig.2009.05.008)
- Calabrese, N., Mastrullo, R., Mauro, A. W., Rovella, P., Tammaro, M., 2015: '*Performance analysis of a rooftop, air-to-air heat pump working with CO₂*', Applied Thermal Engineering 75, 1046-1054. DOI: [10.1016/j.applthermaleng.2014.10.057](https://doi.org/10.1016/j.applthermaleng.2014.10.057)
- Cecchinato, L., Corradi, M., Minetto, S., 2010: '*Energy performance of supermarket refrigeration and air conditioning integrated systems*', Applied Thermal Engineering 30(14-15), 1946-1958. DOI: [10.1016/j.applthermaleng.2010.04.019](https://doi.org/10.1016/j.applthermaleng.2010.04.019)
- Danfoss, 2016: '*Italy's Largest Hypermarket Opts for CO₂ Refrigeration*'. – Available at: <<http://www.danfoss.com/newsstories/rc/italy-largest-hypermarket-opts-for-co2-refrigeration/?ref=17179879870#/>> [accessed 16.06.2017].
- Elbel, S., Lawrence, N., 2016: '*Review of recent developments in advanced ejector technology*', International Journal of Refrigeration 62, 1-18. DOI: [10.1016/j.ijrefrig.2015.10.031](https://doi.org/10.1016/j.ijrefrig.2015.10.031)
- Elbel, S., Hrnjak, P., 2008: '*Experimental validation of a prototype ejector design to reduce throttling losses encountered in transcritical R744 system operate*', International Journal of Refrigeration 31, 411-422. DOI: [10.1016/j.ijrefrig.2007.07.013](https://doi.org/10.1016/j.ijrefrig.2007.07.013)

- European Commission, 2014: '*Regulation (EU) No 517/2014 of the European Parliament and of the Council of 16th April 2014 on fluorinated greenhouse gases and repealing Regulation (EC) No 842/2006*'.
- European Commission, 2008: '*Development and demonstration of a prototype transcritical CO₂ refrigeration system*', Final Report of LIFE Project Number: LIFE05 ENV/DK/000156-CO2REF. – Available at: <http://knudsenkoling.itide.dk/files/Final_report-kbm.pdf> [accessed 15.06.2017].
- Fredslund, K., Kriezi, E. E., Madsen, K. B., Birkelund, M., Olsson, R., 2016: '*CO₂ installations with a multi ejector for supermarkets, case studies from various locations*', Proceedings of the 12th IIR Gustav Lorentzen Natural Working Fluids Conference, 21st – 24th August; Edinburgh, UK. ID: 1105.
- Frigo-Consulting LTD, 2015: '*Carrefour Timisoara: new technology successfully implemented*'. – Available at: <http://www.frigoconsulting.ch/en/news/carrefour_timisoara_ejector.html> [accessed 16.06.2017].
- Ge, Y.T., Tassou, S.A., 2011b: '*Thermodynamic analysis of transcritical CO₂ booster refrigeration systems in supermarkets*', Energy Conversion and Management 52(4), 1868-1875. DOI: [10.1016/j.enconman.2010.11.015](https://doi.org/10.1016/j.enconman.2010.11.015)
- Ge, Y.T., Tassou, S.A., 2011a: '*Performance evaluation and optimal design of supermarket refrigeration systems with supermarket model "SuperSim". Part II: Model applications*', International Journal of Refrigeration 34(2), 540-549. DOI: [10.1016/j.ijrefrig.2010.11.004](https://doi.org/10.1016/j.ijrefrig.2010.11.004)
- Girotto, S., 2017: '*Improved transcritical CO₂ refrigeration systems for warm climates*', Proceedings of the 7th IIR Ammonia and CO₂ Refrigeration Technologies Conference, 11th - 13th May; Ohrid, Macedonia.
- Gullo, P., Tsamos, K. M., Hafner, A., Ge, Y. T., Tassou, S. A., 2017: '*State-of-the-art technologies for transcritical R744 refrigeration systems – A theoretical assessment of energy advantages for European food retail industry*', Proceedings of the 1st International Conference on Sustainable Energy and Resource Use in Food Chains, 19th – 20th April; Berkshire, UK.
- Gullo, P., Hafner, A., Cortella, G., 2017: '*Multi-ejector R744 booster refrigerating plant and air conditioning system integration – A theoretical evaluation of energy benefits for supermarket applications*', International Journal of Refrigeration 75, 164-176. DOI: [10.1016/j.ijrefrig.2016.12.009](https://doi.org/10.1016/j.ijrefrig.2016.12.009)
- Gullo, P., Cortella, G., Minetto, S., Polzot, A., 2016: '*Overfed evaporators and parallel compression in commercial R744 booster refrigeration systems – An assessment of energy benefits*', Proceedings of the 12th IIR Gustav Lorentzen Natural Working Fluids Conference, 21st - 24th August; Edinburgh, UK. ID: 1039.
- Gullo, P., Elmegaard, B., Cortella, G., 2016a: '*Energy and environmental performance assessment of R744 booster supermarket refrigeration systems operating in warm climates*', International Journal of Refrigeration 64, 61-79. DOI: [10.1016/j.ijrefrig.2015.12.016](https://doi.org/10.1016/j.ijrefrig.2015.12.016)
- Hafner, A., Banasiak, K., Fredslund, K., Girotto, S., Smolka, J., 2016: '*R744 ejector system case: Italian supermarket, Spiazzo*', Proceedings of the 12th IIR Gustav Lorentzen Natural Working Fluids Conference, 21st – 24th August; Edinburgh, UK. ID: 1078.
- Hafner, A., Fredslund, K., Banasiak, K., 2015: '*Next generation R744 refrigeration technology for supermarkets*', Proceedings of the 24th IIR International Congress of Refrigeration, 16th - 22nd August; Yokohama, Japan. ID: 768.
- Hafner, A., Schönenberger, J., Banasiak, K., Girotto, S., 2014b: '*R744 ejector supported parallel vapour compression system*', Proceedings of the 3rd IIR International Conference on Sustainability and Cold Chain, 23rd - 25th June; London, UK. ID: 129.
- Hafner, A., Försterling, S., Banasiak, K., 2014a: '*Multi-ejector concept for R-744 supermarket refrigeration*', International Journal of Refrigeration 43, 1-13. DOI: [10.1016/j.ijrefrig.2013.10.015](https://doi.org/10.1016/j.ijrefrig.2013.10.015)
- Hafner, A., Banasiak, K., 2016: '*Full scale supermarket laboratory R744 ejector supported and AC integrated parallel compression unit*', Proceedings of the 12th IIR Gustav Lorentzen Natural Working Fluids Conference, 21st – 24th August; Edinburgh, UK. ID: 1159.
- Hafner, A., 2017: '*Integrated CO₂ system refrigeration, air conditioning and sanitary hot water*' Proceedings of the 7th IIR Ammonia and CO₂ Refrigeration Technologies Conference, 11th - 13th May; Ohrid, Macedonia.

- Hafner, A., 2015: '2020 perspectives CO₂ refrigeration and heat pump systems', Proceedings of the 6th IIR Ammonia and CO₂ Refrigeration Technologies Conference, 16th - 18th April; Ohrid, Macedonia.
- Haida, M., Smolka, J., Palacz, M., Bodys, J., Nowak, A. J., Bulinski, Z., Fic, A., Banasiak, K., Hafner, A., 2016b: 'Numerical investigation of an R744 liquid ejector for supermarket refrigeration systems', Thermal Science 20(4), 1259-1269. DOI: [10.2298/TSCI151210112H](https://doi.org/10.2298/TSCI151210112H)
- Haida, M., Banasiak, K., Smolka, J., Hafner, A., Eikevik, T. M., 2016: 'Experimental analysis of the R744 vapour compression rack equipped with the multi-ejector expansion work recovery module', International Journal of Refrigeration 64, 93-107. DOI: [10.1016/j.ijrefrig.2016.01.017](https://doi.org/10.1016/j.ijrefrig.2016.01.017)
- Hashimoto, K., 2006: 'Technology and market development of CO₂ heat pump water heaters (ECO Cute) in Japan', IEA Heat Pump Centre Newsletter 24(3), 12-16.
- Jakobs, R., Cibis, D., Laue, H., 2010: 'Status And Outlook: Industrial Heat Pumps', Proceedings of the International Refrigeration and Air Conditioning Conference; 12th - 15th July; West Lafayette, USA. ID: 1081.
- Karampour, M., Sawalha, S., 2017: 'Energy efficiency evaluation of integrated CO₂ trans-critical system in supermarkets; a field measurements and modelling analysis', International Journal of Refrigeration (**In Press, Accepted Manuscript**). DOI: [10.1016/j.ijrefrig.2017.06.002](https://doi.org/10.1016/j.ijrefrig.2017.06.002)
- Karampour, M., Sawalha, S., 2015: 'Theoretical analysis of CO₂ trans-critical system with parallel compression for heat recovery and air conditioning in supermarkets', Proceedings of the 24th IIR International Congress of Refrigeration, 16th - 22nd August; Yokohama, Japan. ID: 530.
- Lawrence, N., Elbel, S., 2015: 'Analysis of two-phase ejector performance metrics and comparison of R134a and CO₂ ejector performance', Science and Technology for the Built Environment 21(5), 515-525. DOI: [10.1080/23744731.2015.1030327](https://doi.org/10.1080/23744731.2015.1030327)
- Minetto, S., Cecchinato, L., Brignoli, R., Marinetti, S., Rossetti, A., 2016: 'Water-side reversible CO₂ heat pump for residential application', International Journal of Refrigeration 63, 237-250. DOI: [10.1016/j.ijrefrig.2015.12.015](https://doi.org/10.1016/j.ijrefrig.2015.12.015)
- Minetto, S., Girotto, S., Brignoli, R., Rossetti, A., Marinetti, S., 2015b: 'Air conditioning and space heating with CO₂: efficiency improvement with ejectors', Proceedings of the 6th IIR Ammonia and CO₂ Refrigeration Technologies Conference, 16th - 18th April; Ohrid, Macedonia.
- Minetto, S., Girotto, S., Rossetti, A., Marinetti, S., 2015a: 'Experience with ejector work recovery and auxiliary compressors in CO₂ refrigeration systems. Technological aspects and application perspectives', Proceedings of the 6th IIR Ammonia and CO₂ Refrigeration Technologies Conference, 16th - 18th April; Ohrid, Macedonia.
- Minetto, S., Girotto, S., Salvatore, M., Rossetti, A., Marinetti, S., 2014b: 'Recent installations of CO₂ supermarket refrigeration system for warm climates: data from field', Proceedings of the 3rd IIR International Conference on Sustainability and Cold Chain, 23rd - 25th June; London, UK. ID: 119.
- Minetto, S., Brignoli, R., Zilio, C., Marinetti, S., 2014: 'Experimental analysis of a new method of overfeeding multiple evaporators in refrigeration systems', International Journal of Refrigeration 38, 1-9. DOI: [10.1016/j.ijrefrig.2013.09.044](https://doi.org/10.1016/j.ijrefrig.2013.09.044)
- Minetto, S., Brignoli, R., Banasiak, K., Hafner, A., Zilio, C., 2013: 'Performance assessment of an off-the-shelf R744 heat pump equipped with an ejector', Applied Thermal Engineering 59(1-2), 568-575. DOI: [10.1016/j.applthermaleng.2013.06.032](https://doi.org/10.1016/j.applthermaleng.2013.06.032)
- Nekså, P., Hafner, A., Bredesen, A., Eikevik, T. M., 2016: 'CO₂ as working fluid - Technological development on the road to sustainable refrigeration', Proceedings of the 12th IIR Gustav Lorentzen Natural Working Fluids Conference, 21st - 24th August; Edinburgh, UK. ID: 1133.
- Nekså, P., 2002: 'CO₂ heat pump systems', International Journal of Refrigeration 25(4), 421-427. DOI: [10.1016/S0140-7007\(01\)00033-0](https://doi.org/10.1016/S0140-7007(01)00033-0)

- NeksÅ, P., Rekstad, H., Zakeri, G. R., Schiefloe, P. A., 1998: '*CO₂ heat pump water heater: characteristics, system design and experimental results*', International Journal of Refrigeration 21(3), 172–179. DOI: [10.1016/S0140-7007\(98\)00017-6](https://doi.org/10.1016/S0140-7007(98)00017-6)
- Polzot A., Gullo P., D'Agaro P., Cortella G., 2016b: '*Performance evaluation of a R744 booster system for supermarket refrigeration, heating and DHW*', Proceedings of the 12th IIR Gustav Lorentzen Natural Working Fluids Conference, 21st -24th August; Edinburgh, UK. ID: 1022.
- Polzot A., D'Agaro P., Gullo P., Cortella G., 2016a: '*Modelling commercial refrigeration systems coupled with water storage to improve energy efficiency and perform heat recovery*', International Journal of Refrigeration 69, 313-323. DOI: [10.1016/j.ijrefrig.2016.06.012](https://doi.org/10.1016/j.ijrefrig.2016.06.012)
- Reinholdt, L., Madsen, C., 2010: '*Heat recovery on CO₂ systems in supermarkets*', Proceedings of the 9th IIR Gustav Lorentzen Conference on Natural Working Fluids, 12th – 14th April; Sydney, Australia. ID: 143.
- Sawalha, S., 2013: '*Investigation of heat recovery in CO₂ trans-critical solution for supermarket refrigeration*', International Journal of Refrigeration 36(1), 145-156. DOI: [10.1016/j.ijrefrig.2012.10.020](https://doi.org/10.1016/j.ijrefrig.2012.10.020)
- Sawalha, S., 2008: '*Theoretical evaluation of trans-critical CO₂ systems in supermarket refrigeration. Part II: System modifications and comparisons of different solutions*', International Journal of Refrigeration 31(3), 525-34. DOI: [10.1016/j.ijrefrig.2007.05.018](https://doi.org/10.1016/j.ijrefrig.2007.05.018)
- Schönenberger, J., 2016: '*Experience with R744 refrigerating systems and implemented multi ejectors and liquid overfeed*', Proceedings of the 12th IIR Gustav Lorentzen Natural Working Fluids Conference, 21st - 24th August; Edinburgh, UK. ID: 1107.
- Shecco, 2016: '*F-Gas Regulation shaking up the HVAC&R industry*', October 2016; Brussels, Belgium. – Available at: <<http://publication.shecco.com/publications/view/131>> [accessed 14.06.2017].
- Tsamos, K. M., Ge, Y. T., IDewa Santosa, Tassou, S. A., Bianchi, G., Mylona, Z., 2017: '*Energy analysis of alternative CO₂ refrigeration system configurations for retail food applications in moderate and warm climates*', Energy Conversion and Management (**In Press, Accepted Manuscript**). DOI: [10.1016/j.enconman.2017.03.020](https://doi.org/10.1016/j.enconman.2017.03.020)